

( )

: ADBD2020R\_2020042307165020200810205522101971410912

: 2020-08-10 20:55:22

:  
:  
:

/

( )  
( )

Springer

Taylor & Francis

)

CNKI

-

: 1900-01-01 2020-08-10

//

	0.9%		0%
引	0.9%	总	0.9%
单	0.9%	2016	,
& t;	...		
[ 40]		[ 4505]	[ 40]
[ 1]		[ 40]	[ 40]
[ 1]		[ 0]	[ 40]
<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
0	2	0	0



1.	--	4505
	0.9%( 40)	0.9%( 40)
		( 0)
1	2016	& t;
	...	0.9% 40
	<a href="http://www.vorl.duc.c">http://www.vorl.duc.c</a>	- 2016

“

“

2

6KV630KVA

6KV

( )

1

"

10KV


"

GB50053-2009

2

( )

//



( )

"

GB50053-94

--

--

--PT

--

--

10KV

--

$P=630KVACOS \phi = 0.8$  ( )  
 ( ) 800kw

96A

95MVA

50MVA,

0.5km

a

b

c

d

;

a

Max min:

max : min:

1

A

C

B

4

2

1.5s

5-10A


5-10A DL-11/

3

108

1.25

1ZJ1CFQFHC  
4  
2ZJ2CF+---

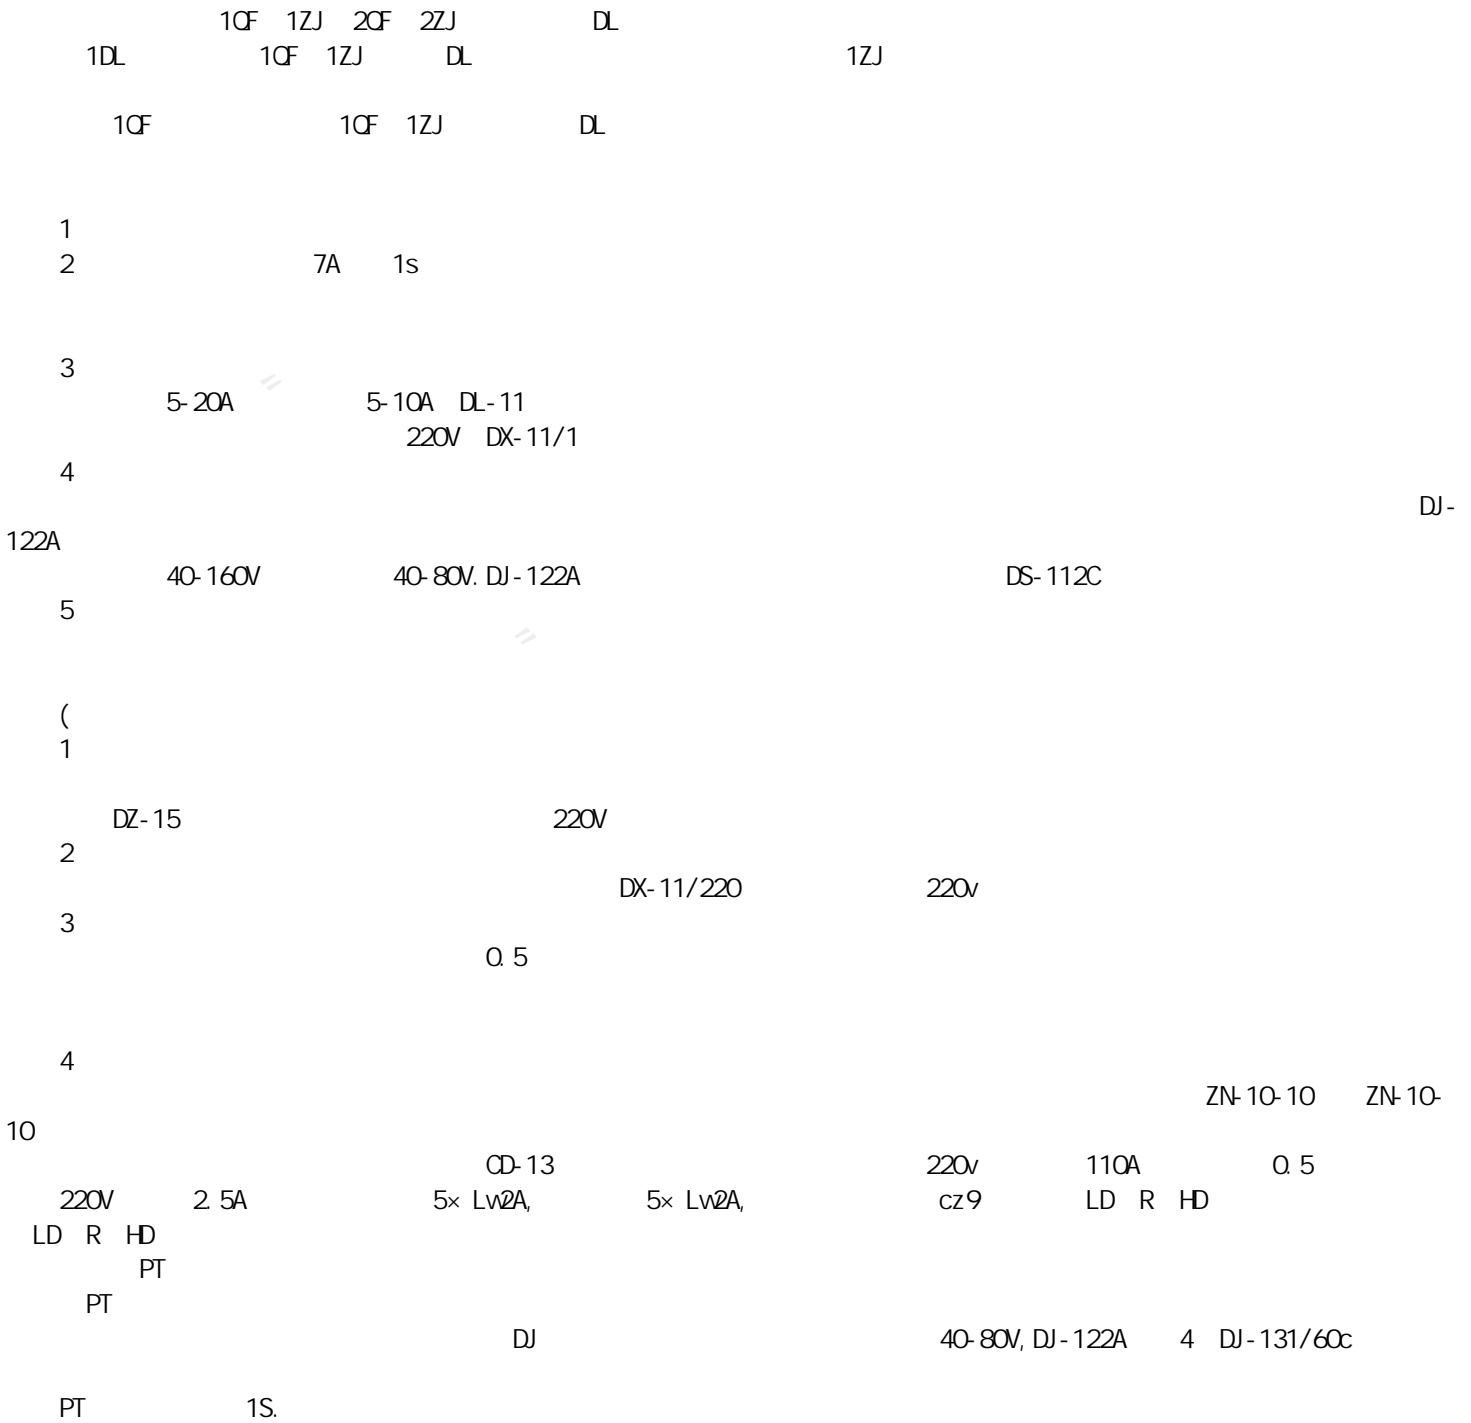

[1] . [M]. 2 2016.  
[3] . [M]. 3 2016.  
[4] . [M]. 1 . 2014.

[5]  
[6]  
[7]  
[8] 10kV

[M]. 2  
GB50052-2009  
GB50053-94

2016.  
. 2009.


1.

- 1.
- 2.
- 3.
- 4.
- 5.
- 6.
- 7.



 [amc@cnki.net](mailto:amc@cnki.net)

 <http://check.cnki.net/>

 <http://e.weibo.com/u/3194559873/>